



Site Address:

1 Sample Home Dr
Anywhere, GA-30000

Inspection Date:

August 01, 2018

Report Prepared For:

Mr & Mrs Sample

Report Prepared By:

NGa Radon Testing
Hoschton
, GA-30548
Phone Number: 770-235-7704

Inspector:

#108491RT

Continuous Radon Monitor

Model Number: 1028
Calibration Date: 06/20/2018
Monitor Time: 8/6/2018 14:51

Serial Number: 207910008
CF: 3.04

Inspection Company

NGa Radon Testing
Hoschton
, GA-30548
Phone Number: 770-235-7704
License Number: 108491RT

Billing Information

Mr & Mrs Sample
1 Sample Home Dr
Anywhere, GA-30000

Site Information

Mr & Mrs Sample
1 Sample Home Dr
Anywhere, GA-30000

Site & Condition

Year Built: 1999
Mitigation System: Not Installed
SqFt: 2964


Atmospheric Condition: Clear and Dry
Structure Type: Single Family
Monitor Location: Unfinished Basement

Test Summary

Start Time: 07/30/2018 10:32
End Time: 08/01/2018 10:32
Measurement Interval(hr): 1.0
Exposure Time: 2 Days 0 hrs

Overall Avg: 7.0 pCi/l
EPA Avg: 7.1 pCi/l

Continuous Radon Monitor Model 1028 S/N: 207910008

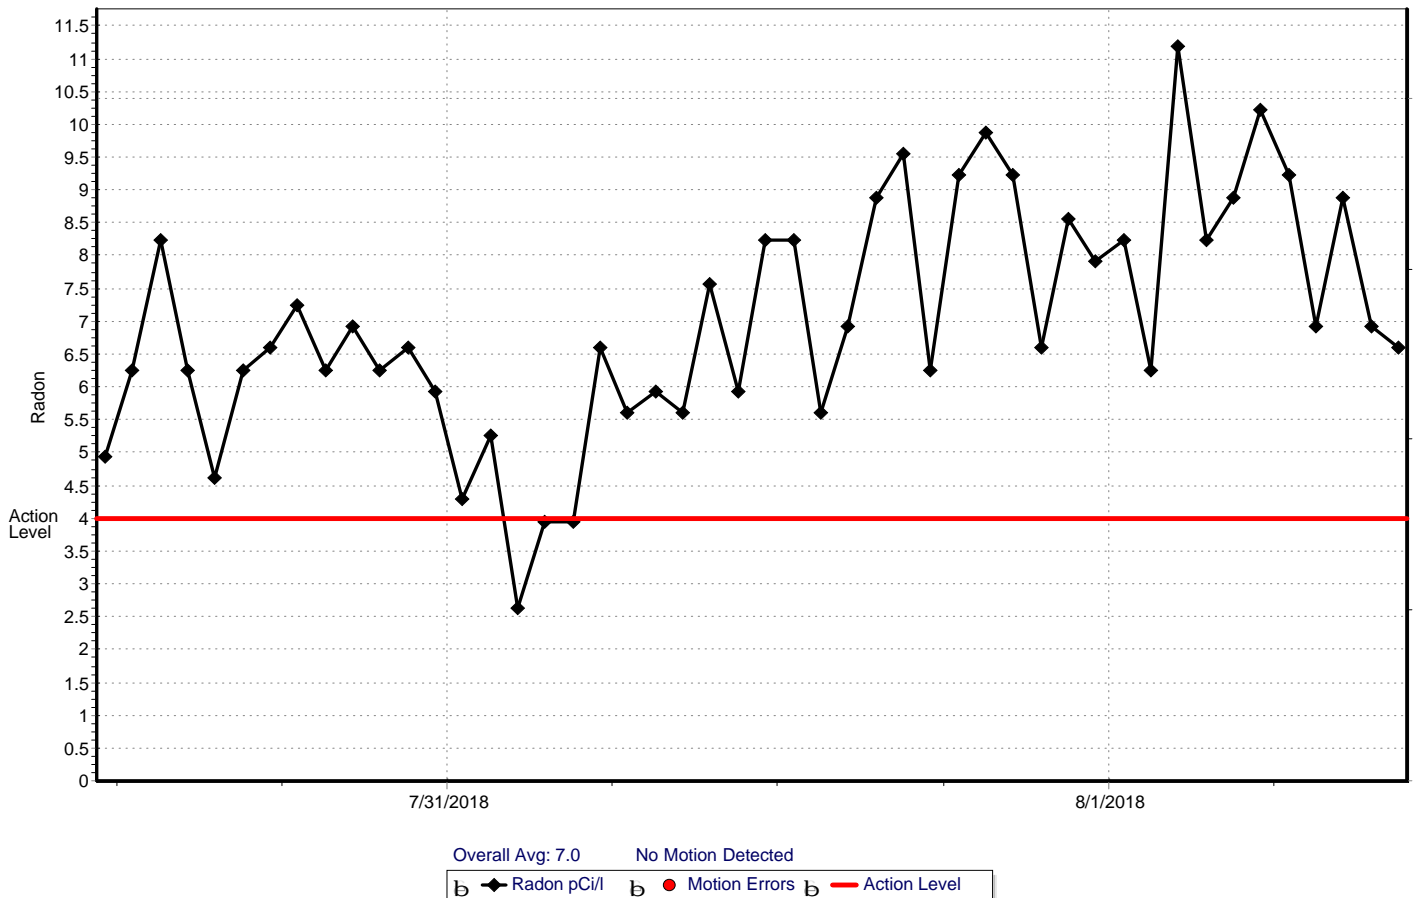

***** 07/30/2018 *****

Time	Counts pCi/l	Flags
11:32	4.9	
12:32	6.3	
13:32	8.2	
14:32	6.3	
15:32	4.6	
16:32	6.3	
17:32	6.6	
18:32	7.2	
19:32	6.3	
20:32	6.9	
21:32	6.3	
22:32	6.6	
23:32	5.9	

***** 07/31/2018 *****

Time	Counts pCi/l	Flags
00:32	4.3	
01:32	5.3	
02:32	2.6	
03:32	4.0	
04:32	4.0	
05:32	6.6	
06:32	5.6	
07:32	5.9	
08:32	5.6	
09:32	7.6	
10:32	5.9	
11:32	8.2	
12:32	8.2	
13:32	5.6	
14:32	6.9	
15:32	8.9	
16:32	9.6	
17:32	6.3	
18:32	9.2	
19:32	9.9	
20:32	9.2	
21:32	6.6	
22:32	8.6	
23:32	7.9	

***** 08/01/2018 *****

Time	Counts pCi/l	Flags
00:32	8.2	

***** 08/01/2018 *****

Time	Counts pCi/l	Flags
01:32	6.3	
02:32	11.2	
03:32	8.2	
04:32	8.9	
05:32	10.2	
06:32	9.2	
07:32	6.9	
08:32	8.9	
09:32	6.9	
10:32	6.6	

Error Flags:

M Motion:

Inspector Signature _____

PC Software Version: 2.2.0

Embedded Software Version: 109

Radon Risk Information

Radon is the second leading cause of lung cancer, after smoking. The US EPA and Surgeon General strongly recommend taking further action when a homes radon test results are 4.0 pCi/l or greater. The concentration of radon in the home is measured in picocuries per liter of air (pCi/l). Radon levels less than 4.0 pCi/l still pose some risk and in many cases may be reduced. If the radon level in the home is between 2.0 and 4.0 pCi/l, the EPA still recommends that you consider fixing the home. The average indoor radon level is estimated to be about 1.3 pCi/l; roughly 0.4 pCi/l of radon is normally found in the outside air. The higher the home radon level, the greater the health risk. Even homes with very high radon levels can be reduced to below 4.0 pCi/l and many homes can be reduced to 2.0 pCi/l or less.

